


Minimum dimensions for installation


BORA Professional 3.0

Minimum dimensions for installation PKA3 + UESDFSL:

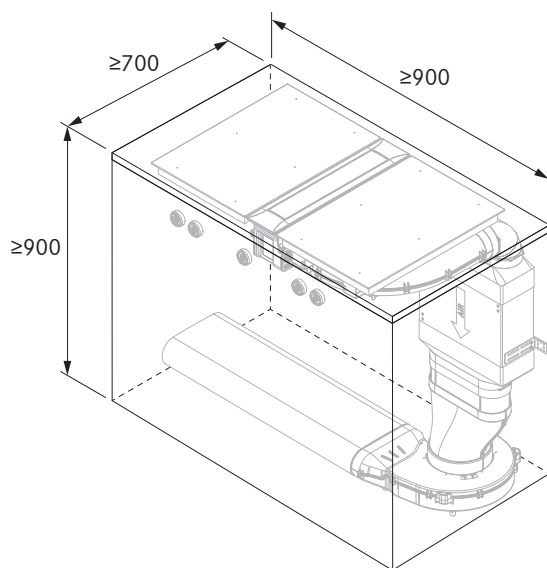


(The bottom drawer must be shortened,
ULS plinth fan with air release to the left)

Minimum dimensions for installation PKA3 + UESDRSL:

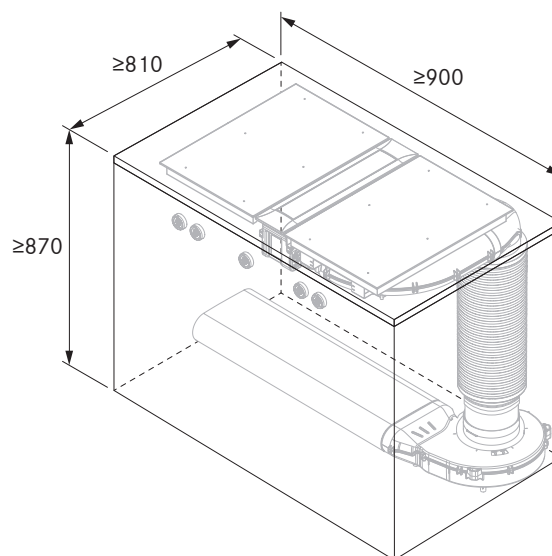

(ULS plinth fan with air release to the left)

Minimum dimensions for installation PKAS3 + EFBV90 + ULBF:

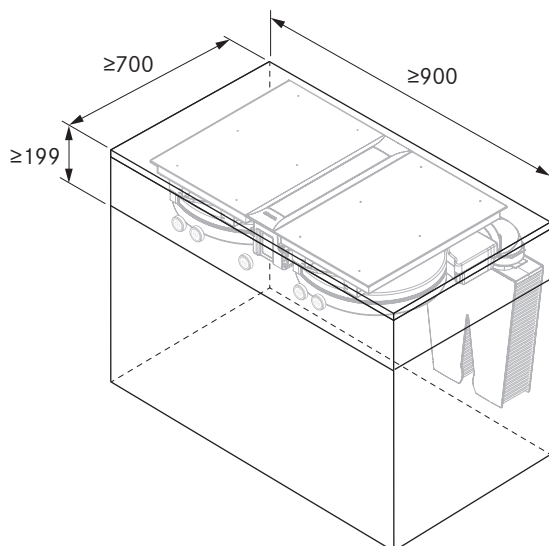

Minimum dimensions for installation 2 PKAS3 (exhaust system):

